




Données Patient	SANOH MOHAMED
Date de naissance	01/01/1984
Age	40
Société	ENVIRO AFRICA
ID	24051013511622407


MEDVIE

Date du test: 10/05/2024 13:53:44
Durée: 12mn 11s
Type test Manuel
Continu

Audiomètre	
Type:	Audio 820M V2,211
Numéro de série:	2111EAT690092
Date Calibration :	30/11/2021

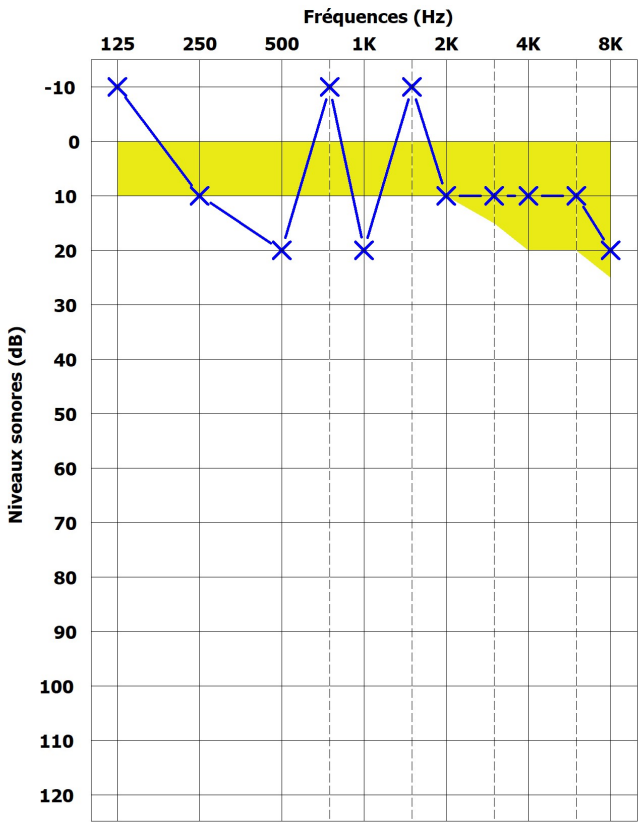

Oreille Gauche

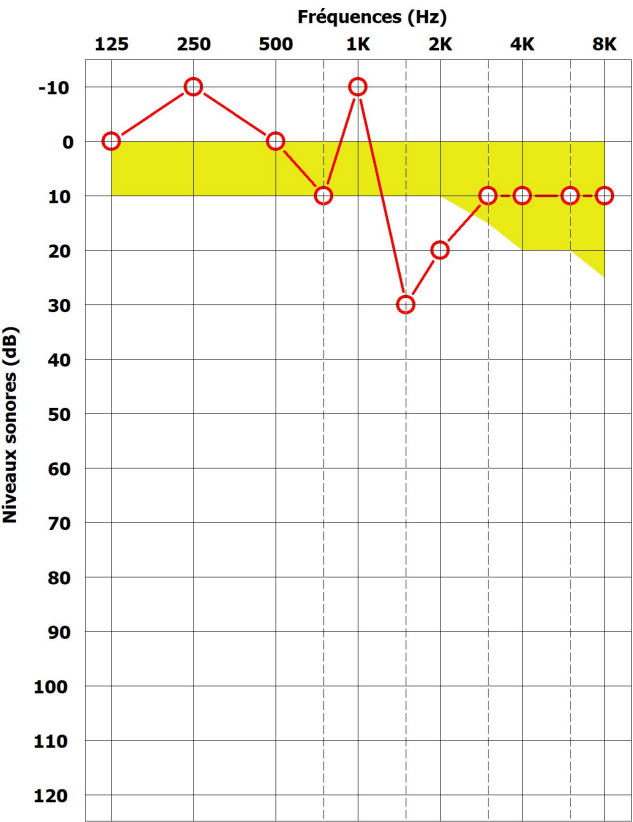

Oreille Droite

	125	250	500	750	1k	1k5	2k	3k	4k	6k	8k
CA Gauche	-10	10	20	-10	20	-10	10	10	10	10	20
CA Droit	0	-10	0	10	-10	30	20	10	10	10	10

Calcul de perte	PAM	IPA
CA Gauche	15,0 dB	10,0 dB
CA Droit	5,0 dB	10,0 dB

Notes